





VANAIRE EQUIPMENT MAINTENANCE CHART

AER 2000 MICROAIRE DAF® SYSTEM

LOCATION	TASK	DAILY	WEEKLY	MONTHLY	3 MONTH	6 MONTH	YEARLY
1	CHECK THAT AERATION SYSTEM PRESSURES ARE AS SPECIFIED (100-110 PSI AT HEADER 25-35 PSI LESS AT SAT. TANK)	✓	-	-	-	-	-
2	CHECK THAT AIR SUPPLY PRESSURE AT THE INLET OF THE FILTER/REGULATOR IS AT LEAST 20PSI HIGHER THAN PRESSURE IN THE HEADER.	✓	-	-	-	-	-
3	CHECK THAT AIR FLOW METER INDICATOR BALL IS IN THE "GREEN " RANGE	✓	-	-	-	-	-
4	CHECK THAT VENT LINE IS EXPELLING AIR AND WATER (APPROXIMATELY 50%/50%)	✓	-	-	-	-	-
5	DRAIN CONDENSATE FROM AIR FILTER/REGULATOR	✓	-	-	-	-	-
6	CHANGE RECIRCULATION PUMP BEARING LUBRICANT	REFER TO MANUFACTURER LITERATURE IN MANUAL					
7	LUBE BEARINGS IN ELECTRIC MOTOR FOR RECYCLE PUMP	REFER TO MANUFACTURER LITERATURE IN MANUAL					

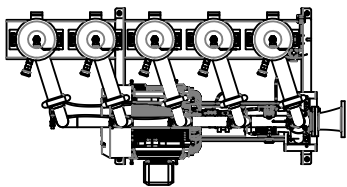

DETAIL "A"

NOTE 1: VIEWS SHOWN ARE A GENERAL REPRESENTATION OF AERATION UNIT COMPONENT ARRANGEMENT. EXACT COMPONENT ARRANGEMENT MAY VARY FROM VIEWS SHOWN.

